



ENCLOSURES DESIGNED FOR THE WORLD'S WATER SYSTEMS™

Specification Submittal Sheet Large Enclosure Series Insulated Enclosures

Materials

- Roof, walls, and drain panel – 5052-H32 marine grade aluminum (.050/18 gauge), mill finish, ASTM B209 outside
- Drain panel hinge and spring – stainless steel
- Insulation 1½" (9 "R" value) minimum thickness polyisocyanurate foam laminated to a glass fiber reinforced facer (each side), non-wicking
- Mounting hardware – 300 series stainless steel or 3003-H14 aluminum
- Wedge anchors – Powers SDI – ½" x 3¾"

Standards

- ASTM B209

Heating Required

- Yes – see separate specification submittal sheet
 No

Dimensions

Model	Inside Dimensions			Concrete Pad			Access Panels*	
	W	L	H	W	L	H**	Qty	Height
LES 96-240-78 (8' x 20' x 6'6")	96	240	78	110	254	6	6	78
LES 108-324-78 (9' x 27' x 6'6")	108	324	78	122	338	6	6	78
LES 120-120-84 (10' x 10' x 7')	120	120	84	134	134	6	2	84
LES 132-156-72 (11' x 13' x 6')	132	156	72	146	170	6	4	72
LES 180-180-96 (15' x 15' x 8')	180	180	96	194	194	6	4	96
LES 180-312-137 (15' x 26' x 11'5")	180	312	137	194	326	6	6	80


These models are a sample of sizes available. Contact our office for specific project needs. All dimensions in inches.

*Access panels are 38¼" wide unless otherwise noted. Drain opening dimensions are 38¼" W x 6½" H.

**130 mph hardware may require a thicker concrete slab.

Specifications

A freeze and vandal protective enclosure shall be installed over above ground plumbing systems. The enclosure shall be constructed of 5052-H32 marine grade aluminum with a minimum R9 in the walls and R18 in the roof. Molded fiberglass enclosures will be rejected. Cut board insulation shall be used for uniform insulation thickness. Sprayed insulation shall be reason for rejection. Redwood post and beams shall be utilized for structural support. The use of "Particle board" shall be reason for rejection. The roof of the enclosure shall be removable for maintenance. Enclosures requiring tape to seal the roof seams are prohibited. The enclosures shall have a fully insulated drain panel designed to remain closed, except when discharging water. The drain panel shall be sized to accommodate the maximum discharge for backflow installations. The enclosure shall be mounted securely to a concrete pad and remain locked even if outside screws are removed. All mounting hardware shall be furnished. The enclosure shall withstand winds up to 110 mph with standard anchoring hardware. Anchoring hardware designed for 130 mph winds will be available upon special request (130 mph hardware may require a thicker concrete slab). When heat is required, a slab mounted UL or ETL listed heater shall be provided that has been independently certified to meet the UL-2021 "Rain Test" for damp or wet conditions. The enclosure shall be manufactured to meet the most recent ASSE Standard 1060 (Class I or Class II) but do not carry the ASSE logo. The insulated enclosure shall be a Safe-T-Cover Series LES.

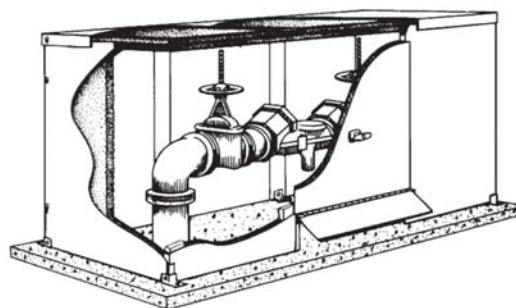

Description

The enclosure is designed to provide freeze and vandal protection of above ground backflow prevention assemblies, meters, PRV, etc. The enclosure provides for safe and easy testing and maintenance. The enclosure disassembles easily if full equipment replacement is needed.

Hydrocowl, Inc.

Nashville, TN • Phone 1-800-245-6333
 FAX (615) 259-4481 • www.safe-t-cover.com